Electric Power – Marketing Spec Sheet Continuous Power Module

CPM500





Continuous Power Module Cat® CPM500

Reliable Power protection for critical applications

The Cat® CONTINUOUS POWER MODULE (Cat CPM) provides constant power protection against surges, sags, and power interruptions that can disrupt operations or cause loss of valuable data or system capacity. Caterpillar engineers have designed the CPM for best reliability and space utilization, and optimized all critical components such as the Generator Set, a high efficient Uninterruptible Power Supply (UPS) and an Automatic Transfer Switch (ATS) as a complete Cat product. In the event of a utility power failure, the Flywheel will maintain the UPS output until the generator has started and the ATS has transferred to the generator supply.

| CPM500 Specifications | | |
|---|---|-----------------------------|
| Continuous Power Output | 500 kVA (450 kW @ PF 0.9) | |
| Voltage | 380/400/415 VAC 3-Phase, 4 wire plus ground | |
| Frequency | 50 Hz +/- 10% max (programmable) | |
| Operating Temperature | 0 to 40°C | 32 to 104°F |
| Storage Temperature | -25 to 70°C | -13 to 158°F |
| Dimensions (ISO 40 ft high Cube) | 12192 x 2,438 x 2,896 mm | 480 x 96 x 114 in |
| Weight | 21400 kg | 47180 lbs |
| Operating Altitude | Up to 1000 meters | Up to 3,281 feet |
| Noise level (Utility online) | 65 dBA @ 1m | |
| Generator Output | 700 kVA (560kW) | |
| Additional Non-critical Power Output available from Generator Set* | 100 kVA* | |
| Noise level (Generator online) | 85 dBA@1m | |
| Fuel tank size (approx. 8 hours autonomy) | 1071 liters | 235 gallons /282 US gallons |

*Based on a minimum Flywheel recharge rate, a minimum of 50kVA is required to recharge each UPS Flywheel.

Features

- Constant Power Protection system UPS / Generator / GenStart Module
- Increased reliability GenStart module provides battery redundancy when starting the generator set
- High system efficiency Optimized systems integration and flywheel energy storage technology
- Easy transport and quick deployment to site Standard ISO container designs (Typically one day crane hire)
- Easy installation on site Simple load cable connections points
- Reduced commissioning times Factory tested
- Scalable Investment Expandable systems as needed
- Maximize usable space in building CPM is an outside weatherproof solution
- Remote Monitoring available Via Modbus
- One safe source of supply / responsibility Engineered and factory tested by Caterpillar and fully supported by the Worldwide Cat Dealer Network.
- Cat CPM fulfills the functionalities of a Diesel Rotary UPS system.

LEHE0506-00

CPM500



| UPS Specifications | | | |
|--|---|--|--|
| Flywheel Type | 500iZ Series Multiple Module System (MMS) | | |
| Number of Flywheels | 2 | | |
| AC Input | | | |
| Maximum kVA / (kW) | 500 (450) | | |
| Input Voltage | 380/400/415 VAC 3-Phase, 4 wire plus ground | | |
| Input Voltage Range | +10% / -15% (programmable), +/-10% at 380 VAC | | |
| Frequency | 50 Hz +/- 10% max (programmable) | | |
| Input Power Factor | 0.99 at rated load and nominal voltage | | |
| Input Current at VAC (amps) | 380 (709), 400 (674), 415 (650) | | |
| Maximum Continuous Input Current (amps) | 800 | | |
| Maximum Non-Continuous Input Current (amps) | 840 | | |
| Walk-in | 1 to 15 seconds (programmable) | | |
| Harmonic Current Distortion | | | |
| Linear load | <3% at 100% load | | |
| Non-linear load | <8% with 100% load | | |
| AC Output | | | |
| Output Voltage | 380/400/415 VAC 3-Phase, 4 wire plus ground | | |
| Output Current VAC (amps) | 380 (761), 400 (723), 415 (696) | | |
| Voltage Regulation (Steady- state) | +/- 1% of nominal for +/- 10% input | | |
| Voltage Regulation (Transient) | +/- 1% within 50 milliseconds for 100% load step | | |
| Frequency | 50 Hz (mains synchronized) normal operation +/2% free running | | |
| Voltage Distortion (THD) | <3% linear loads and <5% 100% non-linear loads | | |
| Flywheel Mode | +/- 1% steady state | | |
| Slew Rate | Adjustable from 0.2 Hz/second to 3.0 Hz/second | | |
| Overall Efficiency | | | |
| Efficiency | 98% | | |
| Standards and Approvals | | | |
| Certifications | EN50091-1-1 | | |
| Approvals | CE Mark | | |
| Surge Withstand | Meets IEEE 578 / ANSI C62.41 | | |

CPM500



| Generator set Specifications | | | |
|------------------------------|--|-------------------------|--|
| Model | Cat® C18 | | |
| Electrical Power Output | 700kVA Standby Power Rated ¹ | | |
| Engine | | | |
| Engine Model | C18 ATAAC, I-6 4-stroke water-cooled diesel | | |
| Displacement | 18.13 L | 1106.36 in ³ | |
| Governor Type | Caterpillar ADEM™ Control System | | |
| Fuel System | Electronic Unit Injection | | |
| Generator | | | |
| Frame Size | LC7024H | | |
| Excitation | Internal Excitation | | |
| Pitch | 0.6667 | | |
| Insulation | UL 1446 Recognized Class H with tropicalization and anti-abrasion | | |
| Overspeed Capability (%) | 150 | | |
| Wave form deviation (%) | 2 | | |
| Voltage regulator | Single phase sensing | | |
| Voltage Regulation | Less than +/- 0.5% (steady state), Less than +/- 0.5% (with 3% speed change) | | |

UPS Generator Set Integration

By cancelling harmonic distortion, the UPS operates seamlessly with the generator set to provide a higher total electrical load capacity without oversizing the generator set. Cat UPS effectively insulates the generator set from block loads and transient, and can improve its fault clearing capabilities. The CPM is factory tested and all programmable integration parameters adjusted at factory that assures greater system reliability and improves the total system operation.

UPS Lower Operating Cost

Caterpillar's high operating efficiency (>97%) means yearly savings versus many other UPS products. In addition, lower Cat UPS heat rejection reduces up front HVAC costs and electrical consumption over the life of the product.

UPS Superior Design

Superior system design and the use of robust digital components throughout the system yield the most reliable and trouble-free UPS system on the market. Protection is delivered in the industry's smallest package with the highest efficiency and superior performance.

Automatic Transfer Switch

A 4-pole, Open Transition Automatic Transfer Switch will switch the load between the utility source and the generator. It is fully rated to the generator output and incorporates convenient customer connections for Continuous and Non-critical load. Connection points are also available for load bank testing or a rental generator set.



Standard Factory Installed & Tested Equipment

| Features | Description | | |
|---|---|--|--|
| Flywheel Energy Storage | Compact, battery free, low cost maintenance / operation Generator friendly Harmonic Cancellation, Voltage regulation and power factor improvement | | |
| Starting System | GenStart module provides up to 1725 cold cranking amps @ 24 VDC and is redundant to the generator set starting batteries for highest system reliability. Battery charger integrated. | | |
| Control system | LCD monitor/control HMI panel installed on UPS/ATS/Generator set. Monitoring and alarms for critical components with self-diagnostics. Two (2) warning tower lights installed on exterior of container. | | |
| Communication with Integrated System | Integral modem for remote communication. MODBUS (RTU or TCP/IP). Remote notification and monitoring via Ethernet and e-mail. RS232 or RS485 serial connection. Real-time monitoring software available (UPS View / EMCP Monitoring Software). | | |
| Cooling System | Louvers installed on input and output of the container. Redundant cooling fans on UPS with speed regulation by temperature control unit. | | |
| Engine Coolant System | Jacket water heater. Coolant level sight gauge. | | |
| Heat Recovery System | UPS heat discharged to engine compartment to enhance generator starting capability. | | |
| Switchgear Integration | Automatic Transfer Switch (ATS) – controlled by microprocessor-based unit. Integrated maintenance bypass. Convenient customer connection for continuous load and non-critical load output. | | |
| Fuel System | Integrated fuel system with fuel tank, primary fuel filter with integral water separator, secondary fuel filters and fuel priming pump. | | |
| Lube oil | Fumes disposal. Gear lube oil pump. | | |
| Service | Coolant drain line with valve terminated at edge of base. Oil drain line. Weather hood at rear doors for UPS maintenance. Container doors location designed for easy access. Connection points for load bank testing or rental generator connection. | | |
| Container Packaging | Entire system is packaged in industrial type ISO container prepared for quick handling, transport and installation on site. | | |
| Emergency Power Off (EPO) | Local Emergency Power Off button installed on UPS and generator control panel. Two (2) installed on the exterior of the container at each access door. | | |
| Certifications and Standards | EU Certificate of Conformance 2006/42/EC Machinery Directive (MD) 2006/95/EC Low Voltage Directive (LV) 89/336/EEC EMC Directive EN 12601 Reciprocating internal combustion engine driven generating sets EN 61439 Low voltage switchgear and control gear assemblies EN 62040-1 Uninterruptible Power Systems (UPS) – General and safety requirements for UPS EN 60204 Safety of machinery – Electrical equipment of machines 2000/14/EC Noise emission by outdoor equipment | | |
| | CSC plated via Lloyd's register of shipping | | |

CPM500




Optional Equipment & Service

- Non-critical load power output breakers
- Switchgear for customized projects
- Integrated Load Bank circuit breaker for generator load testing
- Fire-fighting system
- Automatic fuel transfer pumps
- Lower noise level
- Arctic (-30 °C) and tropical (+50 °C) ambient temperature conditions
- Factory witness test

World Wide Product Support

- Cat Dealers provide extensive post sale support including maintenance and repair agreements.
- One single service contract for the complete Cat CPM
- Cat dealers have over 1,800 dealer branch stores operating in 200 countries.
- The Cat S•O•SSM program cost effectively detects internal engine component condition, even the
 presence of unwanted fluids and combustion by-products.

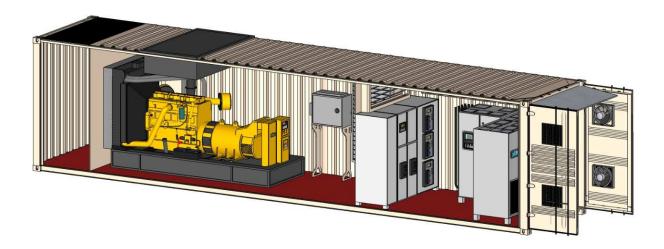

¹ Standby Generator Set Rating definition


Output available with varying load for the duration of the interruption of the normal source power. Average power output is 70% of the standby power rating. Typical operation is 200 hours per year, with maximum expected usage of 500 hours per year.


LEHE0506-00


Electric Power – Marketing Spec Sheet Continuous Power Module

CPM500



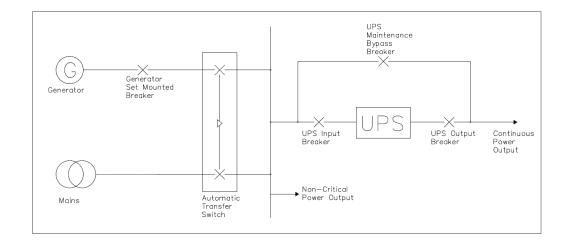

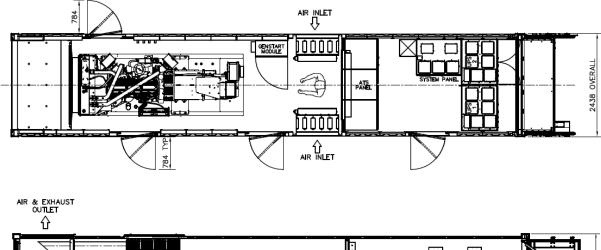

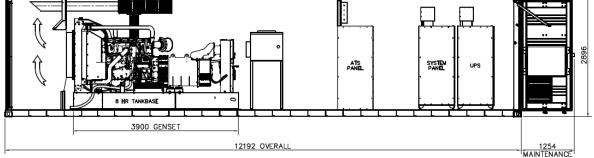

Materials and specifications are subject to change without notice. The International System of Units (SI) is used in this publication. CAT, CATERPILLAR, their respective logos, ADEM, S•O•S, "Caterpillar Yellow" and the "Power Edge" trade dress, as well as corporate and product identity used herein, are trademarks of Caterpillar and may not be used without permission.

©2014 Caterpillar All Rights Reserved

LEHE0506-00

Page 6 of 6